



TYPICAL WIRING DIAGRAM

NOTES:


1. ALL UNITS ARE DESIGNED IN ACCORDANCE WITH INDUSTRY STANDARDS.
2. TRANSFORMERS ARE DRY-TYPE, CLASS AA, VENTILATED, OPEN-STYLE ASSEMBLY FOR INDOOR/CONTROL PANEL USE.
3. TRANSFORMER ARE BASE MOUNTED.
4. TRANSFORMERS ARE CONSTRUCTED BASED UPON A 40°C AMBIENT ENVIRONMENT.
5. MAINTAIN 1" CLEARANCE FROM ALL LIVE PARTS.

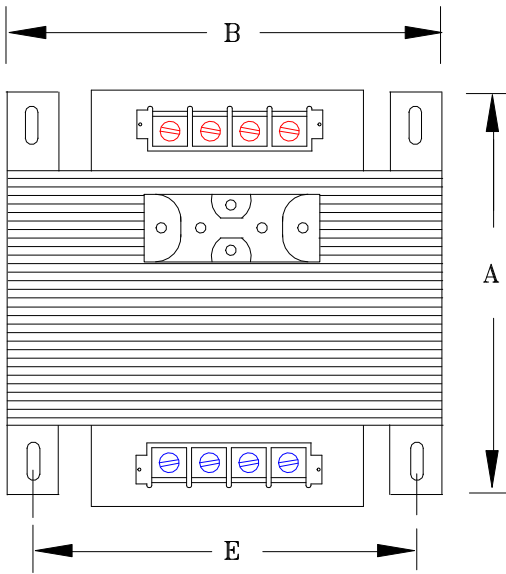

FRONT VIEW

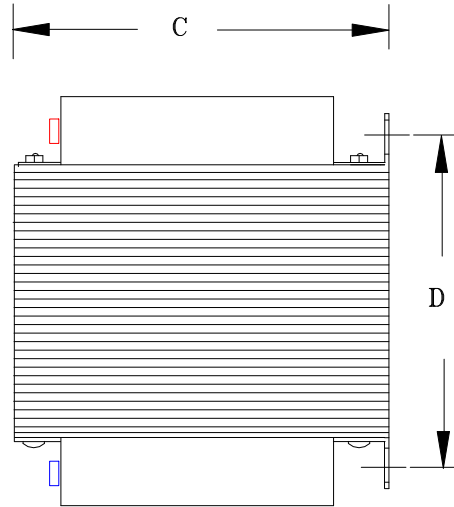

SIDE VIEW

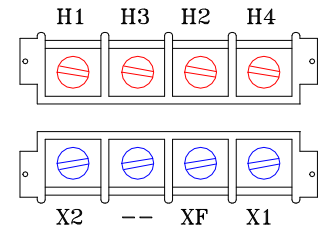

TERMINAL VIEW

APPROXIMATE DIMENSIONS (INCHES)

| KVA | A | B | C | D | E | PRIMARY FUSE BLOCK * | PRIMARY FUSE BLOCK COVER | PRIMARY TERMINAL COVER | SECONDARY TERMINAL COVER | lbs. |
|-------|------|------|------|------|------|----------------------|--------------------------|------------------------|--------------------------|------|
| 0.350 | 4.75 | 4.50 | 4.00 | 3.75 | 3.75 | TPTC-1006-1 | TPTC-1006-2 | TPTC-1011-A | TPTC-1011-B | 12 |

* IF YOU PURCHASE THE PRIMARY FUSE BLOCK, IT WILL ADD 1.50" TO THE "C" DIMENSION
 ** IF YOU UTILIZE THE SECONDARY FUSE CLIPS, THEY WILL ADD 0.50" TO THE "C" DIMENSION

DRAWINGS
 APPROVAL
 RECORD
 OTHER

| | | | | | |
|------------------------|--|-----------|----------------------------|---|--|
| PRIMARY VOLTAGE | 240 x 480 | CUST. | XXXXXXXX | | |
| SECONDARY VOLTAGE | 24 | JOB | | | |
| TEMPERATURE RISE IN °C | 80 | CATALOG | | | |
| WINDINGS & TERMINALS | <input type="checkbox"/> ALUMINUM <input checked="" type="checkbox"/> COPPER | NOTE | XXXXXXXX | | |
| FREQUENCY HERTZ | 50/60 | BY | ENG. LOG. | TITLE 1-PHASE, 600 VOLT CLASS CONTROL DRY TYPE TRANSFORMER | |
| PRIMARY TAPS | NONE | DATE | | | |
| POWERTRAN | REV | MFG. LOG. | DWG. NO. B350PU7JKF | | |
| | DATE: | DWG. FILE | | | |