



TYPICAL WIRING DIAGRAM

NOTES:


1. ALL UNITS ARE cUL LISTED & DESIGNED ACCORDANCE WITH INDUSTRY STANDARDS.
2. TRANSFORMERS ARE DRY-TYPE, CLASS AA, VENTILATED, OPEN-STYLE ASSEMBLY FOR INDOOR/CONTROL PANEL USE.
3. TRANSFORMER ARE BASE MOUNTED.
4. TRANSFORMERS ARE CONSTRUCTED BASED UPON A 40°C AMBIENT ENVIRONMENT.
5. MAINTAIN 1" CLEARANCE FROM ALL LIVE PARTS.

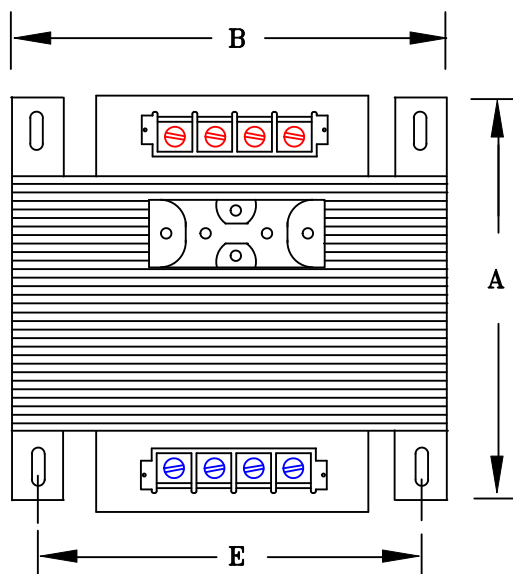

FRONT VIEW

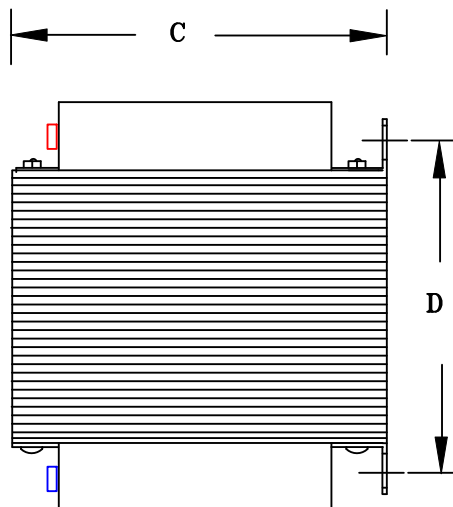

SIDE VIEW

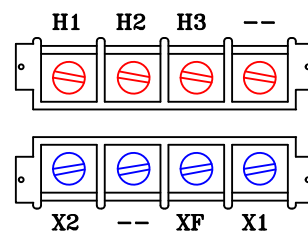

TERMINAL VIEW

APPROXIMATE DIMENSIONS (INCHES)

| KVA | A | B | C | D | E | PRIMARY FUSE BLOCK * | PRIMARY FUSE BLOCK COVER | PRIMARY TERMINAL COVER | SECONDARY TERMINAL COVER | lbs. |
|-------|------|------|------|------|------|----------------------|--------------------------|------------------------|--------------------------|------|
| 0.250 | 4.38 | 4.50 | 4.00 | 2.82 | 3.75 | TPTC-1006-1 | TPTC-1006-2 | TPTC-1011-A | TPTC-1011-B | 10 |

* IF YOU PURCHASE THE PRIMARY FUSE BLOCK, IT WILL ADD 1.50" TO THE "C" DIMENSION

** IF YOU UTILIZE THE SECONDARY FUSE CLIPS, THEY WILL ADD 0.50" TO THE "C" DIMENSION

DRAWINGS
☒ APPROVAL
☐ RECORD
☐ OTHER

| | | | |
|------------------------|--|----------|-------------|
| PRIMARY VOLTAGE | 208-277 | CUST. | XXXXXXXX |
| SECONDARY VOLTAGE | 120 | JOB | |
| TEMPERATURE RISE IN °C | 80 | CATALOG | |
| WINDINGS & TERMINALS | <input type="checkbox"/> ALUMINUM <input checked="" type="checkbox"/> COPPER | NOTE | XXXXXXXX |
| FREQUENCY HERTZ | 50/60 | BY | ENG. LOG. |
| PRIMARY TAPS | NONE | DATE | TITLE |
| | | REV | MFG. LOG. |
| | | DATE: | DWG. FILE |
| | | DWG. NO. | B250MQ15XKF |

POWERTRAN