



TYPICAL WIRING DIAGRAM

NOTES:


1. ALL UNITS ARE cUL LISTED & DESIGNED ACCORDANCE WITH INDUSTRY STANDARDS.
2. TRANSFORMERS ARE DRY-TYPE, CLASS AA, VENTILATED, OPEN-STYLE ASSEMBLY FOR INDOOR/CONTROL PANEL USE.
3. TRANSFORMER ARE BASE MOUNTED.
4. TRANSFORMERS ARE CONSTRUCTED BASED UPON A 40°C AMBIENT ENVIRONMENT.
5. MAINTAIN 1" CLEARANCE FROM ALL LIVE PARTS.

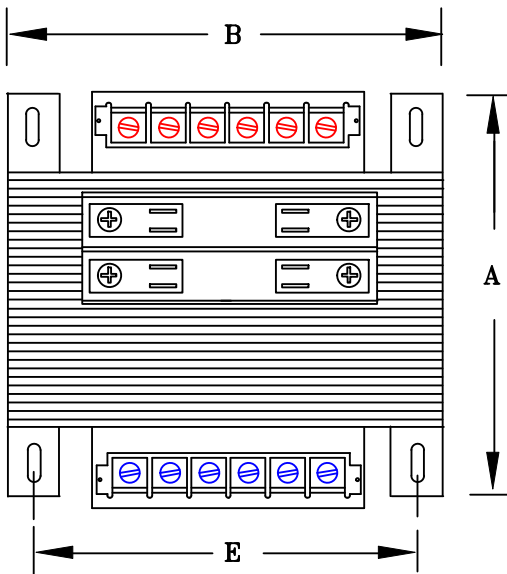

FRONT VIEW

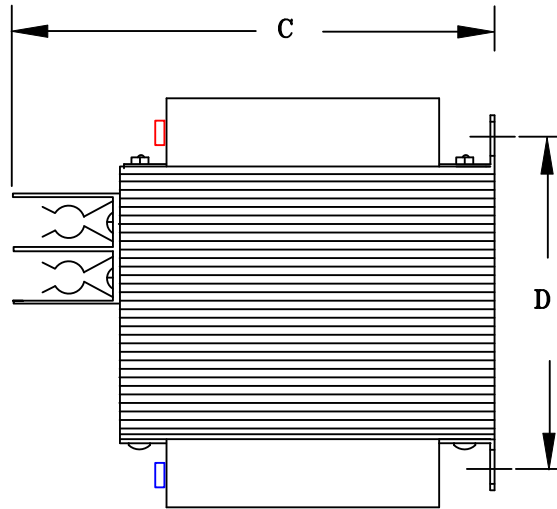

SIDE VIEW

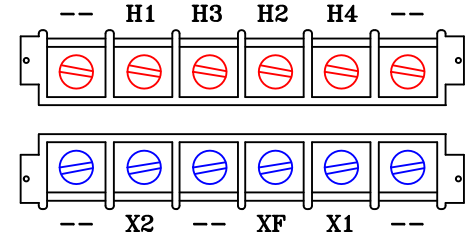

TERMINAL VIEW

APPROXIMATE DIMENSIONS (INCHES)

| KVA | A | B | C | D | E | PRIMARY FUSE BLOCK * | PRIMARY FUSE BLOCK COVER | PRIMARY TERMINAL COVER | SECONDARY TERMINAL COVER | lbs. |
|-----|------|------|------|------|------|-------------------------|-----------------------------|---------------------------|-----------------------------|------|
| 1.5 | 8.11 | 6.75 | 7.25 | 6.12 | 6.12 | TPTC-1006-1 | TPTC-1006-2 | TPTC-1012-A | TPTC-1012-B | 50 |

DRAWINGS
☒ APPROVAL
☐ RECORD
☐ OTHER

| | | | |
|------------------------|--|----------|--|
| PRIMARY VOLTAGE | 230 x 460 | CUST. | XXXXXXXX |
| SECONDARY VOLTAGE | 115 | JOB | |
| TEMPERATURE RISE IN °C | 80 | PRI: | (1) 2-POLE PRIMARY FUSE BLOCK (CLASS CC FUSES) |
| WINDINGS & TERMINALS | <input type="checkbox"/> ALUMINUM <input checked="" type="checkbox"/> COPPER | SEC: | |
| FREQUENCY HERTZ | 50/60 | BY | ENG. LOG. |
| PRIMARY TAPS | NONE | DATE | |
| | | REV | MFG. LOG. |
| | | DATE: | DWG. FILE |
| | | TITLE | 1-PHASE, 600 VOLT CLASS CONTROL DRY TYPE TRANSFORMER |
| | | DWG. NO. | B1K5BTZ13RBF |