


TYPICAL WIRING DIAGRAM

**NOTES:**

1. ALL UNITS ARE cUL LISTED & DESIGNED ACCORDANCE WITH INDUSTRY STANDARDS.
2. TRANSFORMERS ARE DRY-TYPE, CLASS AA, VENTILATED, OPEN-STYLE ASSEMBLY FOR INDOOR/CONTROL PANEL USE.
3. TRANSFORMER ARE BASE MOUNTED.
4. TRANSFORMERS ARE CONSTRUCTED BASED UPON A 40°C AMBIENT ENVIRONMENT.
5. MAINTAIN 1" CLEARANCE FROM ALL LIVE PARTS.

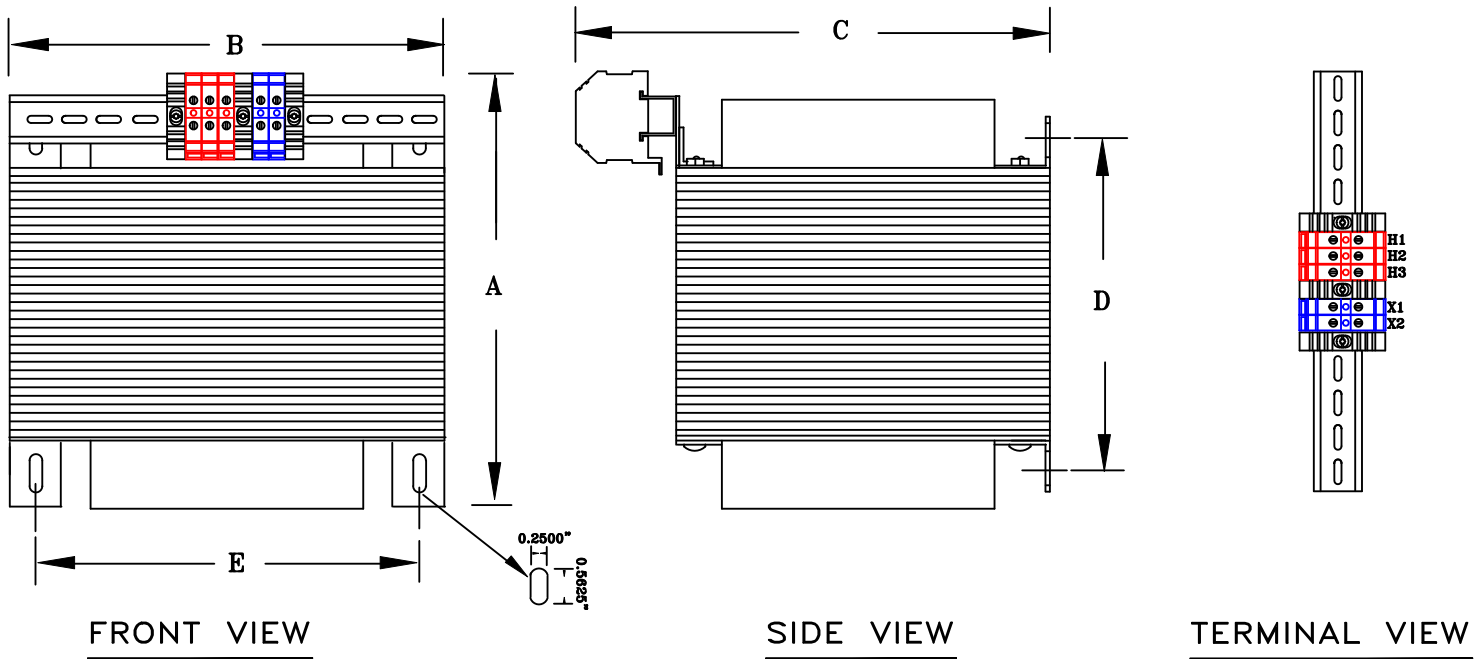

**APPROXIMATE DIMENSIONS ( INCHES )**

| KVA | A    | B    | C    | D    | E    | F    | G    | HARDWARE | (4) MTG SLOTS   | STEEL  | lbs. | WEATHER SHIELD | TERMINAL TYPE |
|-----|------|------|------|------|------|------|------|----------|-----------------|--------|------|----------------|---------------|
| 2.0 | 6.00 | 6.38 | 7.63 | 4.12 | 5.31 | ---- | ---- | 1/4-20   | 0.250" x 0.562" | EI-212 | 30   | N/A            | TBs           |

\* ELECTROSTATIC SHIELD GROUNDED TO TRANSFORMER CASE AT FACTORY ( IF APPLICABLE )

DRAWINGS  
 APPROVAL  
 RECORD  
 OTHER

|                        |  |         |           |   |
|------------------------|--|---------|-----------|---|
| PRIMARY VOLTAGE        | 208-277  | CUST.   | XXXXXXXX  |   |
| SECONDARY VOLTAGE      | 120  | JOB     |           |   |
| TEMPERATURE RISE IN °C | 115  | CATALOG |           |   |
| WINDINGS & TERMINALS   | <input type="checkbox"/> ALUMINUM <input checked="" type="checkbox"/> COPPER | NOTE    | XXXXXXXX  |   |
| FREQUENCY IN HERTZ     | 60   | BY      | ENG. LOG. | TITLE<br>1-PHASE, 600 VOLT CLASS ISOLATION DRY TYPE TRANSFORMER |
| PRIMARY TAPS           | NONE   | DATE    |           |   |
|                        |  | REV     | MFG. LOG. | DWG. NO.  |
|                        |  | DATE:   | DWG. FILE | F943FST2000   |